


PLAN VIEW

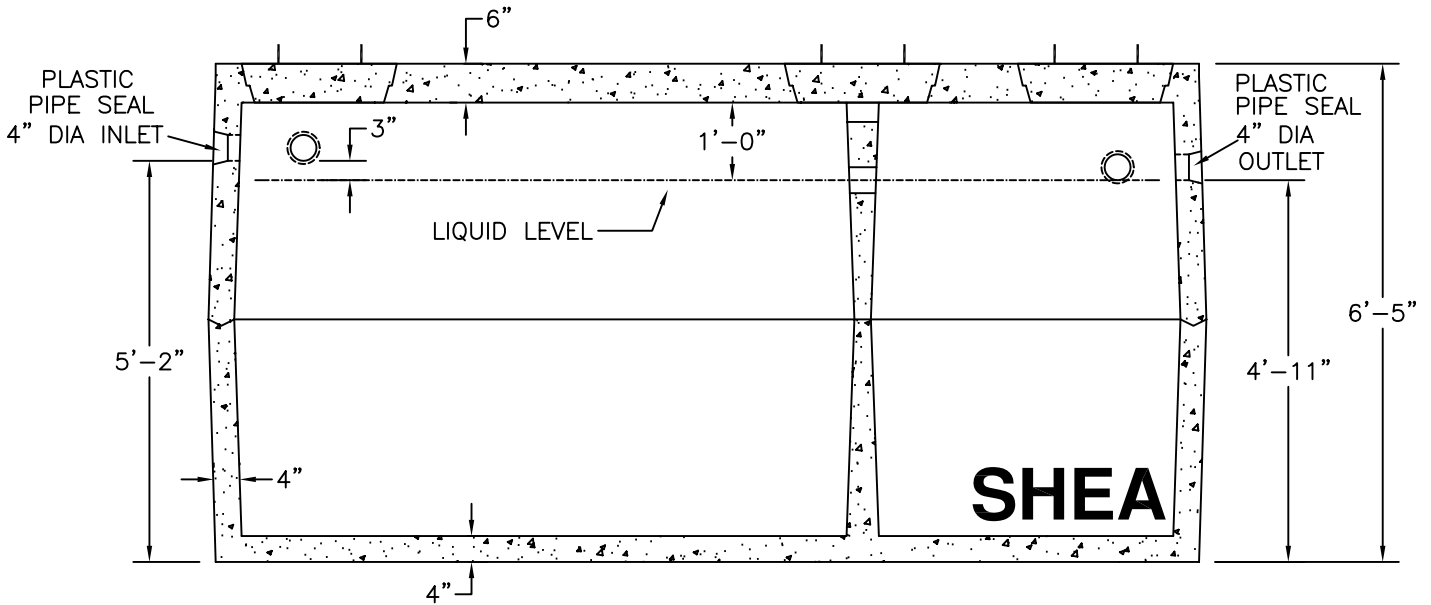

SECTION VIEW

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS, FOR SEPTIC TANKS.
3. ALL REINFORCEMENT PER ASTM C1227-93.
4. TEES AND GAS BAFFLE SOLD SEPARATELY.
5. TONGUE & GROOVE JOINT SEALED WITH BUTYLE RESIN.
6. ALSO AVAILABLE IN H-20 LOADING.

			WEIGHT
ITEM NO.	TK-25002C	STANDARD	22,650#
	TK-25002CH	H20	22,650#



**NEW ENGLAND
CONCRETE PRODUCTS, INC.**

SEPTIC TANK
2500 GALLON (1665/835)
2-COMPARTMENT