


PLAN VIEW

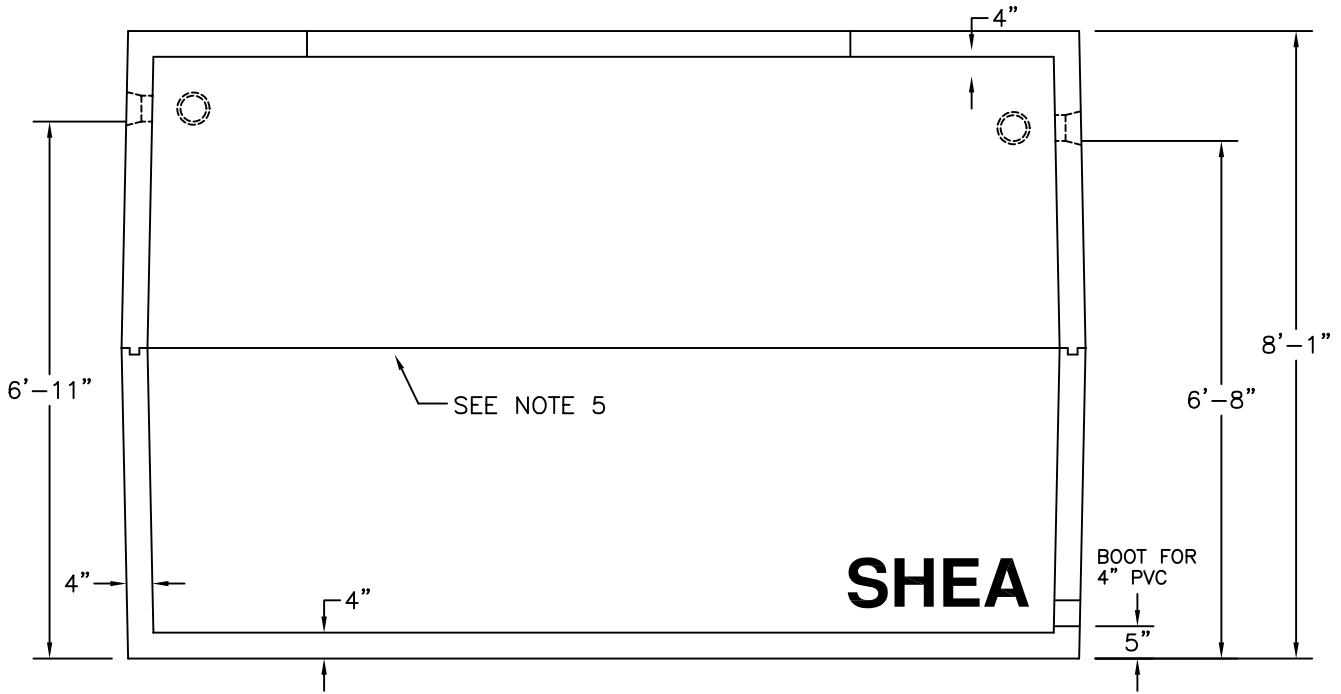

SECTION VIEW

|          |           |        |         |
|----------|-----------|--------|---------|
| ITEM NO. | TK 3000SF | WEIGHT | 20,725# |
|----------|-----------|--------|---------|

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. CONSTRUCTION OF SEPTIC TANK CONFORMS WITH DEP TITLE 5 REGS, 310 CMR, SECTION 15.226.
3. ALL REINFORCEMENT PER ASTM C1227-93.
4. TONGUE & GROOVE JOINT SEALED WITH BUTYLE RESIN.

**E.F. SHEA**  
**NEW ENGLAND**  
**CONCRETE PRODUCTS, INC.**

SAND FILTER  
 3000 GALLON