


PLAN VIEW

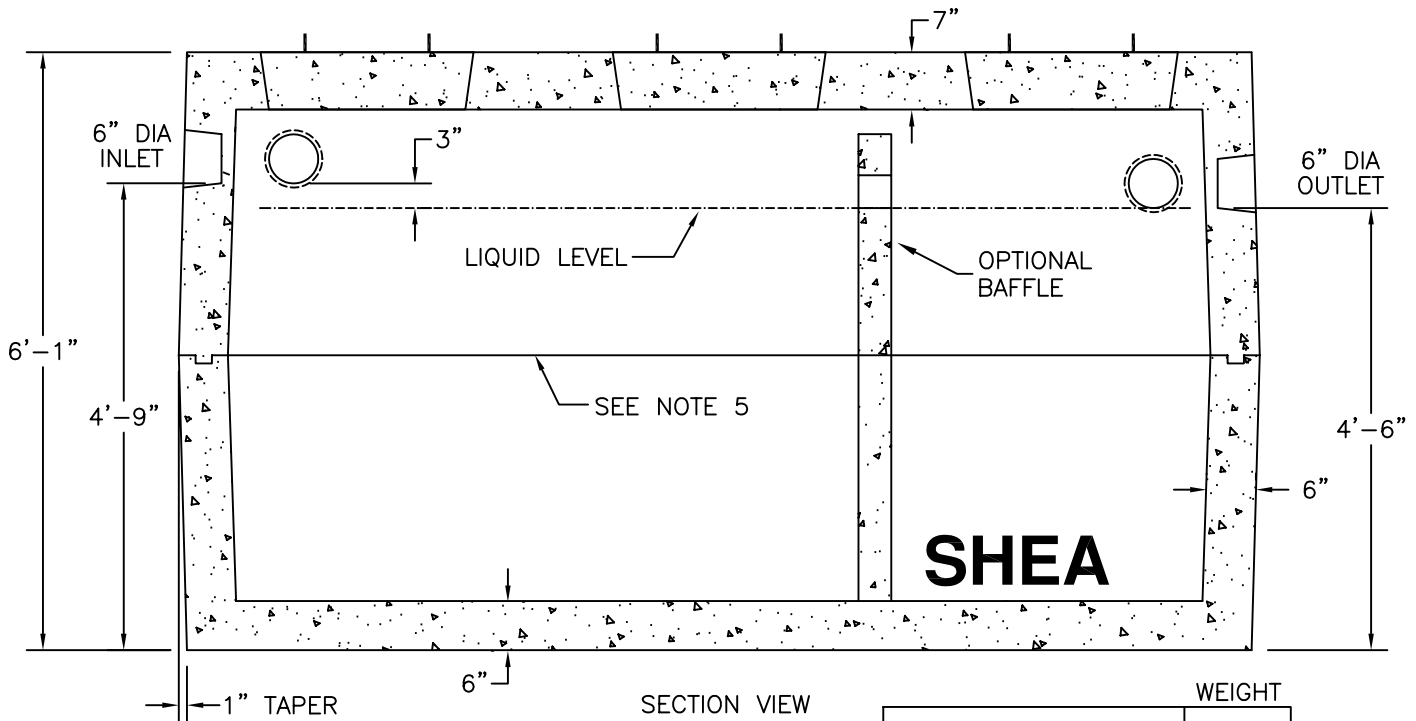

SECTION VIEW

WEIGHT

ITEM NO. TK-1500C	22,840#
-------------------	---------

NOTES:

1. CONCRETE: 5,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS, FOR SEPTIC TANKS.
3. ALL REINFORCEMENT PER ASTM C1227-93.
4. DESIGNED FOR H-20 LOADING.
5. TONGUE & GROOVE JOINT SEALED WITH BUTYLE RESIN.
6. TEES AND BAFFLES SOLD SEPARATELY.

E. F. SHEA
NEW ENGLAND
CONCRETE PRODUCTS, INC.

COMMERCIAL LINE
 SEPTIC TANK
 1500 GALLON